


ケーブル敷設図

キュービクル警報配線系統図

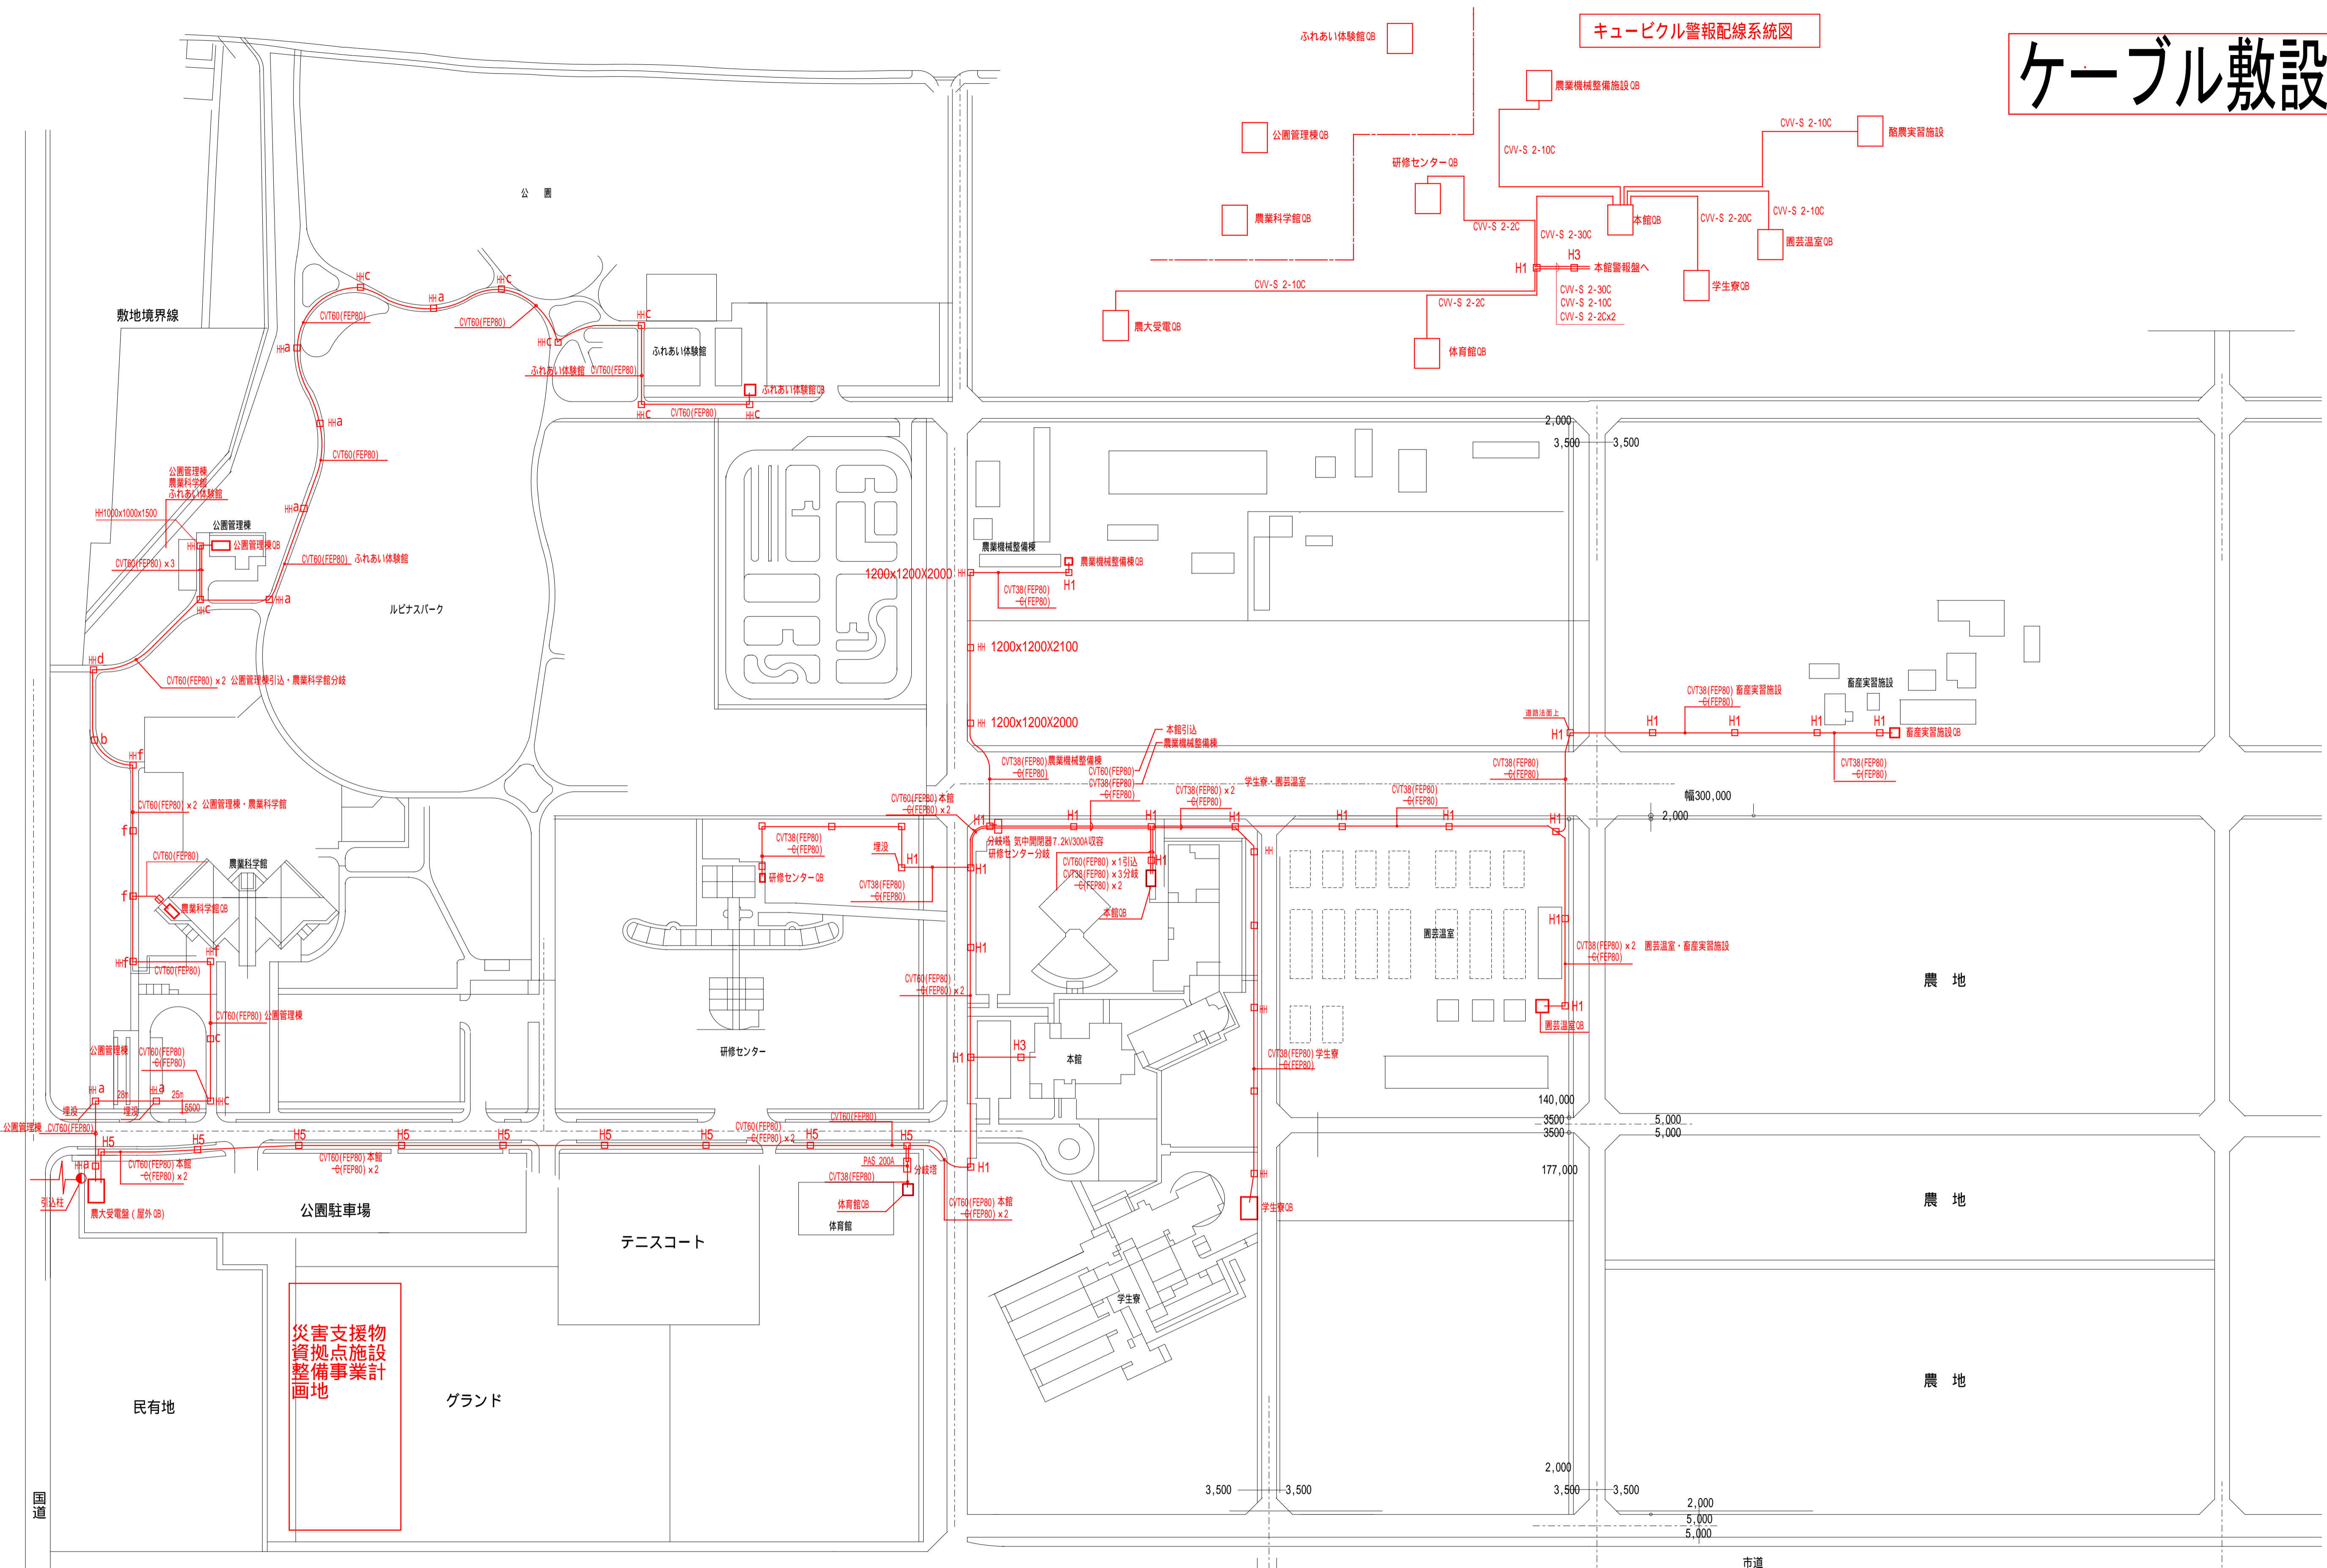

災害支援物資拠点施設整備事業計画地

- | | |
|--|---|
| <ul style="list-style-type: none"> □ HH a 900x900x900 (R60-2t) □ HH b 900x900x900 (R60-2t) セバ付 □ HH c 900x900x900 (R60-8t) □ HH d 900x900x900 (R60-8t) セバ付 □ HH e 1200x1200x1200 (R60-2t) □ HH f 1200x1200x1200 (R60-2t) セバ付 □ HH g 1200x1200x1200 (R60-8t) セバ付 □ HH h 1200x1200x1200 (R60-8t) | <ul style="list-style-type: none"> □ H1 1200x1200x1500 □ H3 600x600x900 □ H5 1200x1200x1500(化粧蓋) |
|--|---|
- 凡例 — 6kVケーブル埋設線路